

Merlin 3000S



Demand Control Kitchen Ventilation System



INSTALLATION & OPERATION MANUAL

Please read these instructions carefully and retain for future use.

These instructions can be downloaded in electronic form on the product website (www.snsnorthern.com) or a printed version can be ordered free of charge via S&S Northern Limited.



Contents

- Important Information 3**
- Installation 4**
 - General Product Information 4
 - System Positioning 4
 - Electrical Connections 5
 - Access & Navigate Settings 10
 - Settings Switch #1 Overview 11
 - Settings Switch #2 Overview 12
 - Duct Temperature vs 0-10V Fan Output 13
- Operation 15**
 - Initial Power Up 15
 - Adjust the Screen Brightness 15
 - Fan Boost Button 16
 - Warning Status Screens 16
 - Fault Status Screens 17
- Maintenance 18**
- Technical Specification 19**

Important Information

Warning Symbol

- ⚠ Where this symbol is used, consult the manual to understand any potential hazards and how to avoid them.
- ⚠ **The information contained within this manual should be referenced for typical installation and operation only.**
- ⚠ **Isolate the equipment from all hazardous live power sources before opening the cover.**
- ⚠ **Any parts that form part of the connections/installation must have a minimum fire-retardant rating of UL 94 V-1.**
- ⚠ **For site specific requirements that may deviate from the information in this guide – contact your supplier.**
- ⚠ **If the equipment is used in a manner not specified, the safety provided by the equipment may be impaired.**
- ⚠ **This device is designed for indoor operation only.**
- ⚠ **Never ignore your device when in alarm.**
- ⚠ **This device requires a continual supply of electrical power – it will not work without power.**
- ⚠ **This device should not be used to substitute proper installation, use and/or maintenance of fuel burning appliances including appropriate ventilation and exhaust systems.**
- ⚠ **The device is not intended for use in potentially explosive atmospheres.**
- ⚠ **Your product should reach you in perfect condition, if you suspect it is damaged, contact your supplier.**

Warranty Statement

All products are engineered, designed and 100% quality tested in accordance with the latest internationally recognised standards under a Quality Management System that is certified to ISO 9001. The manufacturer warrants to the original consumer purchaser, that this product will be free of defects in material and workmanship for a period of three (3) years from date of purchase. The manufacturer's liability hereunder is limited to replacement of the product with repaired product at the discretion of the manufacture. This warranty is void if the product has been damaged by accident, unreasonable use, neglect, tampering or other causes not arising from defects in material or workmanship. This warranty extends to the original consumer purchaser of the product only.

Any implied warranties arising out of this sale, including but not limited to the implied warranties of description, merchantability and intended operational purpose, are limited in duration to the above warranty period. In no event shall the manufacturer be liable for loss of use of this product or for any indirect, special, incidental, or consequential damages, or costs, or expenses incurred by the consumer or any other user of this product, whether due to a breach of contract, negligence, strict liability in tort or otherwise. The manufacturer shall have no liability for any personal injury, property damage or any special, incidental, contingent, or consequential damage of any kind resulting from gas leakage, fire, or explosion. This warranty does not affect your statutory rights.

During the above warranty period, your product will be replaced with a comparable product if the defective product is returned together with proof of purchase date. The replacement product will be in warranty for the remainder of the original warranty period or for six months – whichever is the greatest.

Information for consumers of electrical & electronic equipment.

When this product has reached the end of its life, treat as Waste Electrical & Electronics Equipment (WEEE). Any WEEE marked products must not be mixed with general household waste, but kept separate for the treatment, recovery and recycling of the materials used.



Please contact your supplier or local authority for details of recycling schemes in your area.

Installation & Configuration

General Product Information

For optimum results and protection, all system sensing elements should be utilised together, but any combination can be used.

The Merlin 3000S is an energy saving system designed specifically for commercial kitchens. The system acts an interlock between the ventilation and the gas solenoid valve, while also varying the speed of the ventilation via a 0-10vdc output.

The system has 2 built-in 0-10VDC outputs. This is designed to vary the speed of the ventilation system(s) based on either, real-time gas usage via a turbine gas meter, Carbon Dioxide (CO₂) levels in the area, smoke/steam detection in the canopy using optical sensors or heat detection in the extract ductwork using a thermostat. For the best and most accurate results, all should be used together but any combination of the 4 sensors can be used.

As the CO₂ or gas usage increases in the commercial kitchen, the Merlin 3000S will increase the speed of the ventilation system to provide the perfect cooking environment. Conversely, when only minimal gas is being used and the CO₂ levels are low, the Merlin 3000S will reduce the speed of the ventilation systems, saving energy and money.

The optical sensor will increase the ventilation should it detect excess smoke or steam in the canopy along with the duct mounted heat sensor to monitor excess heat in the duct.


The Merlin 3000S also carries out its duty as a traditional ventilation interlock and gas pressure proving system alongside the ventilation on demand capabilities. This allows for one single small control panel in the kitchen, freeing up valuable real estate on the kitchen walls.

System Positioning

| | |
|--------------------------------------|----------------------------------------------------------------------------------------------------------------------------------|
| Merlin 3000S | In accordance with any applicable regulations. Easy accessibility is recommended for both status observation and alarm purposes. |
| Merlin CO₂ Monitor | 1-3m away from canopy. >1m from any draft zones and 1.7m from ground level / Breathing zone. |
| Merlin CO Detector | 1.7m from ground level / Breathing zone. |
| Optical Sensor | Fitted inside of canopy. 5m Max from infra-red reflector fitted opposite sensor. |
| Duct Temp Sensor | Fitted inside of ductwork where heat may pass through. |
| Speed Controller | Install away from Merlin 3000S panel to avoid electrical noise. |

If in doubt, contact your supplier.

Electrical Connections

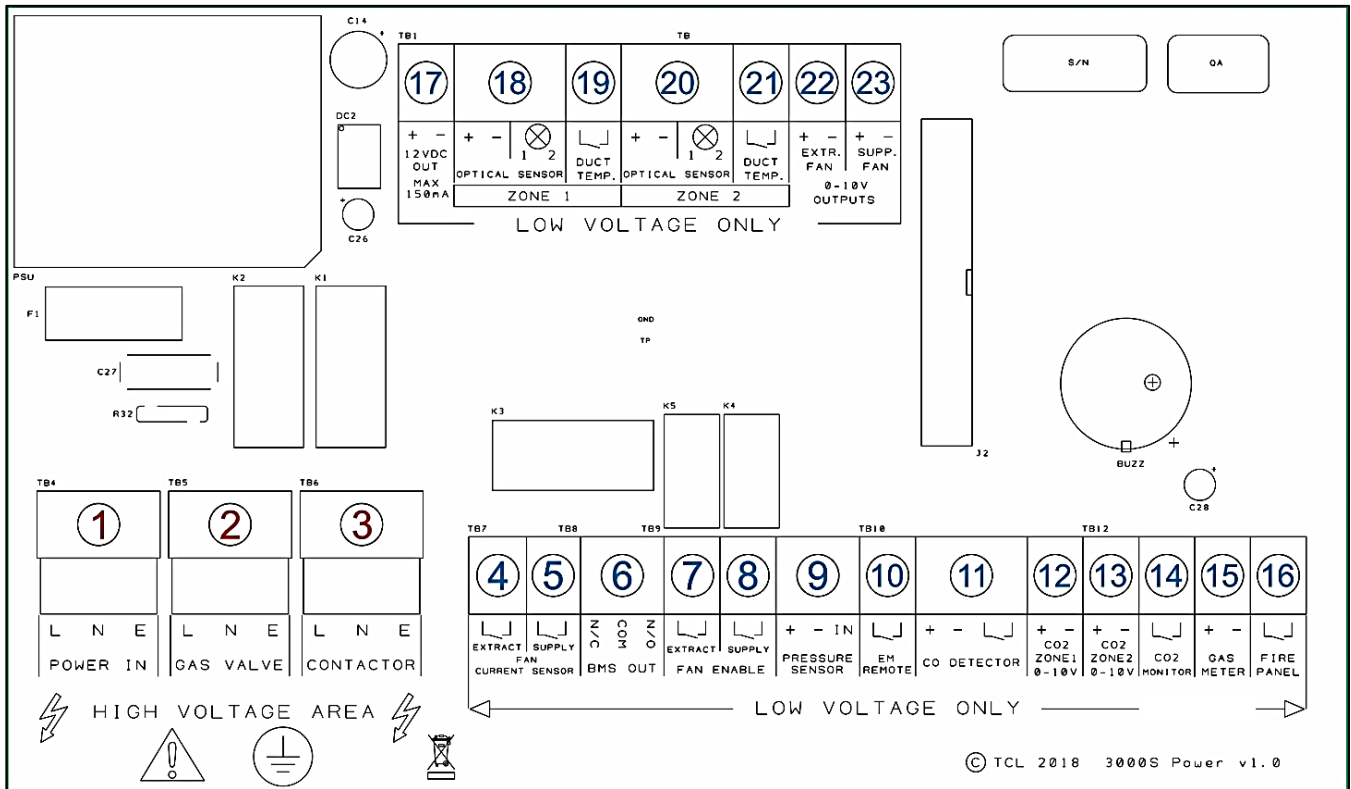

1 POWER IN

The Merlin 3000S requires an AC single phase power supply rating of 100-240V~ connected to [Power In] terminal using a 3A fuse spur. Frequency 50-60Hz.

2 GAS VALVE

100-240V AC Power Output to a gas solenoid valve. Refer to the gas valve for more information.

3 CONTACTOR

100-240V AC Power Output to an Electrical Contactor. Maximum current of the valve and Contactor combined should not be loaded over 3 Amps.

4 FAN CURRENT SENSOR - Extract

These terminals are used to receive an input signal from external air pressure switches or external current monitors. These terminals are linked out as a factory setting. Wiring to air pressure differential switches and current monitors should be made using two-core volt free connections.

5 FAN CURRENT SENSOR - Supply

These terminals are used to receive an input signal from external air pressure switches or external current monitors. These terminals are linked out as a factory setting. Wiring to air pressure differential switches and current monitors should be made using two-core volt free connections.

NOTE: Current Sensor Terminals not in use should be left with link screwed in. e.g., if only one fan is used.

6 BMS OUT

Terminals are available for Building Management Systems (BMS) to make or break a circuit (gas valve open or valve closed). Terminations: Normally Closed / Common / Normally Open. These are volt free connections.

7 FAN ENABLE - Extract


This terminal will switch when the key is turned on and off.

These terminals are linked to a fan switch (speed controllers supplied separately) which can provide power to the fans when the panel is switched on. This can work as normally closed (N/C) or normally open (N/O).

8 FAN ENABLE – Supply


This terminal will switch when the key is turned on and off.

These terminals are linked to a fan switch (speed controllers supplied separately) which can provide power to the fans when the panel is switched on. This can work as normally closed (N/C) or normally open (N/O).

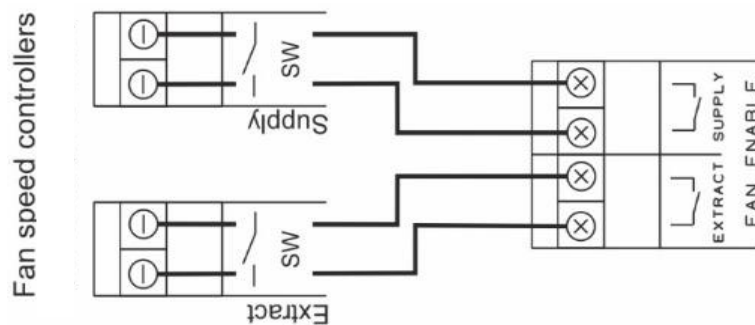

9 PRESSURE SENSOR

Connect to the gas pressure transducer (supplied separately) to these terminals and connect to the downstream port on the gas solenoid valve. Operating pressure: Min = 12mbar Max = 100mbar

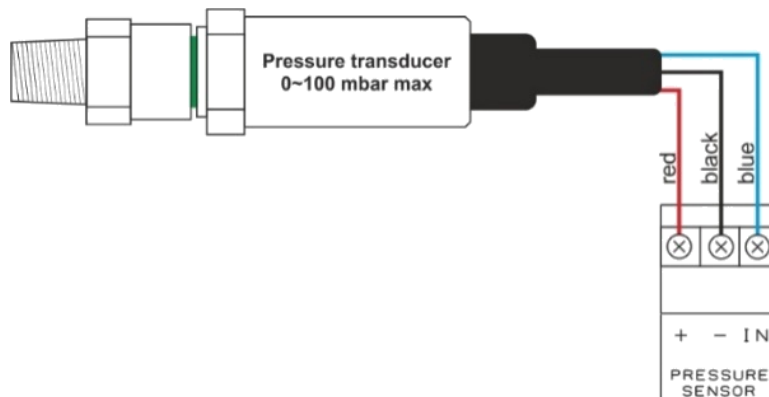


10 EM REMOTE

This terminal is linked out as a factory setting and used for remote emergency shut off devices that are volt free and wired using two-core cable.

11 CO DETECTOR

12V DC Power [+ / -] and [] can be wired to a Merlin Carbon Monoxide (CO) gas detector.

If no detector is being used leave the link in between the “ ”.

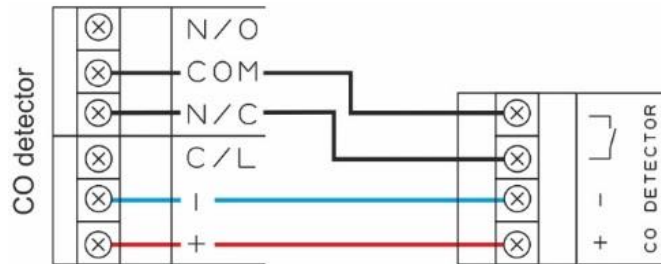


12 CO2 Zone 1 0-10V Input

A 0-10VDC signal from a Merlin CO₂ Monitor will automate the speed of extract and supply fans dependant on CO₂ detected levels detected.

13 CO2 Zone 2 0-10V Input

A 0-10VDC signal from a Merlin CO₂ Monitor will automate the speed of extract and supply fans dependant on CO₂ detected levels detected.

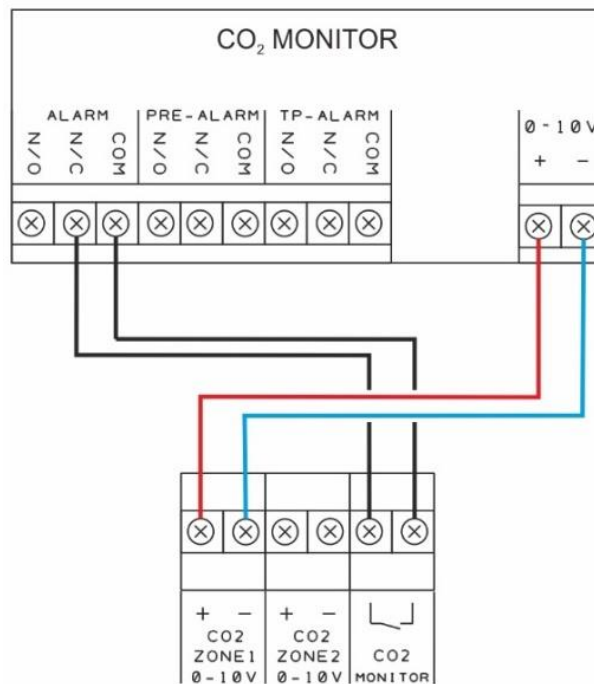


14 CO2 MONITOR

This is a linked-out terminal and can be connected to a Merlin Carbon Dioxide (CO₂) monitor. If no CO₂ Monitor is being used - leave the link in between the “ ” terminal.

15 GAS METER

Before any connections are made, please refer to the Gas Meter operation manual. This is a low voltage connection with a varied pulse input to drive fans on an automatic varied speed based on real-time gas usage.

NOTE: TBX – Turbine Gas Meter has two types of pulse output – 'unit pulse' and 'high density pulse'. The Merlin 3000S requires a high-density pulse wire.

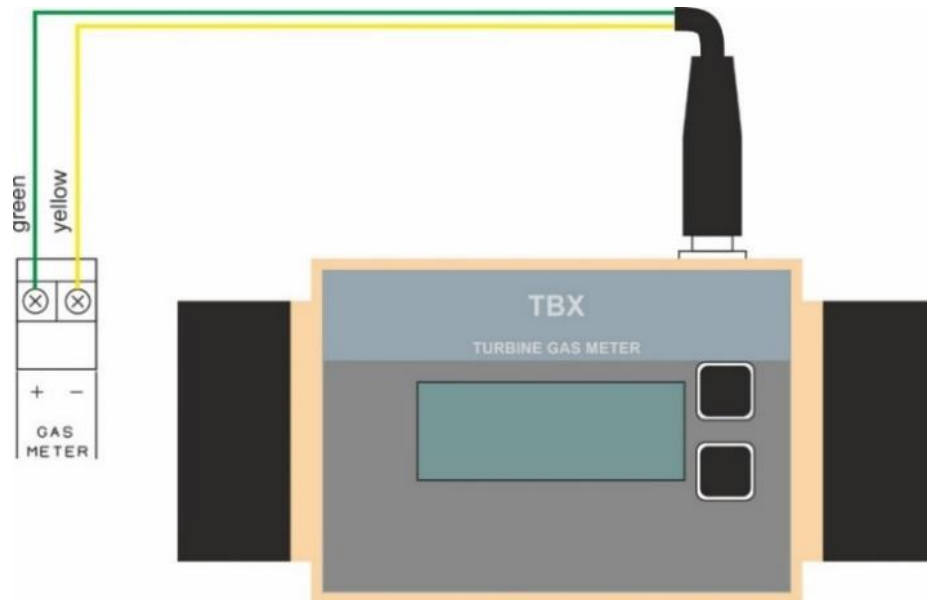

16 FIRE PANEL


The terminal for fire alarms is detailed on the circuit board as [FIRE PANEL]. These connections are linked out as a factory setting. Fire alarms should be volt free using two-core cable- normally closed and open upon activation.

17 12VDC OUT

This is a permanent 12V DC output (max loading 150mA/~2W) when there is power at the panel. This is normally used to power a Merlin PM2+ Current Monitor (supplied separately).

18 OPTICAL SENSOR (ZONE 1)

The terminals detailed on the circuit board as [OPTICAL SENSOR] - [+ / -] [1 / 2] are wired to the optical sensor (supplied separately).

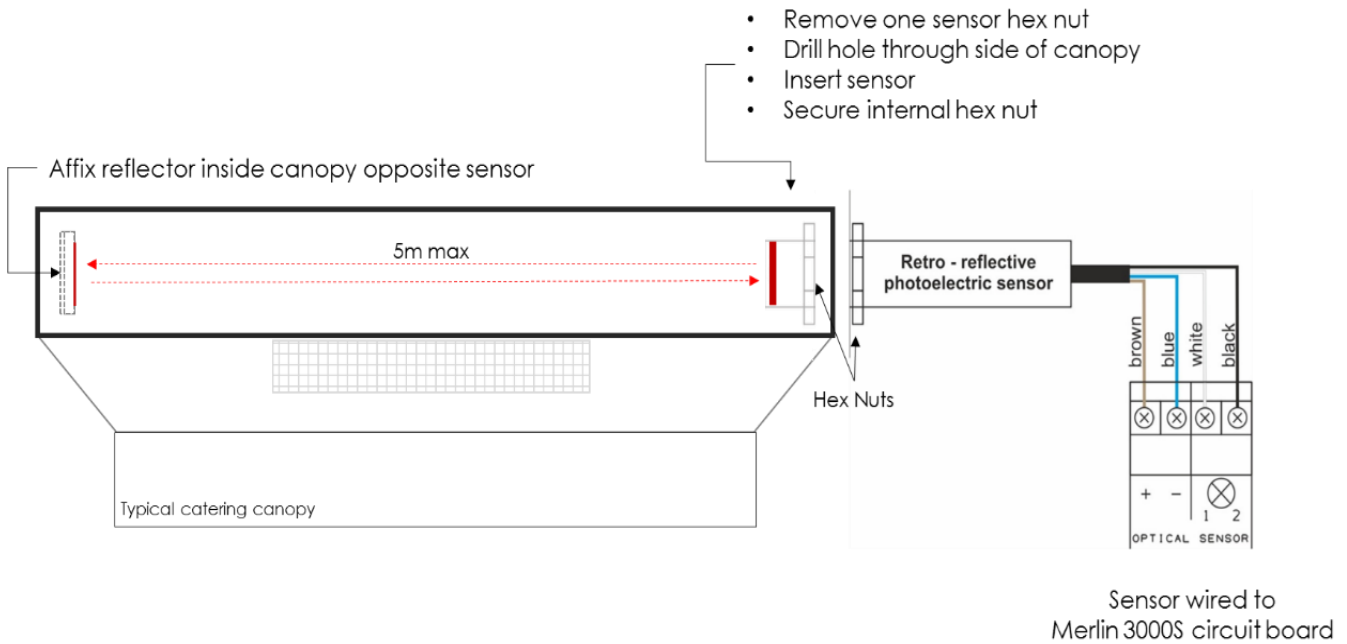

19 DUCT TEMP (ZONE 1)

This is a low resistance connection to a Heat Probe to drive fans on an automatic varied speed based on extraction temperature levels. Connect the Blue & White wires of the probe back to the 3000S.

20 OPTICAL SENSOR (ZONE 2)

See OPTICAL SENSOR (ZONE 1)

21 DUCT TEMP (ZONE 2)


See DUCT TEMP (ZONE 1)

22 0-10V OUTPUT – Extract Fan

The terminals for the 0-10VDC outputs are detailed on the circuit board as [EXTR. FAN] & [SUPP. FAN]. These connections are used to regulate external fan speed controllers (supplied separately) which can accept this control signal.

23 0-10V OUTPUT – Supply Fan

The terminals for the 0-10VDC outputs are detailed on the circuit board as [EXTR. FAN] & [SUPP. FAN]. These connections are used to regulate external fan speed controllers (supplied separately) which can accept this control signal.

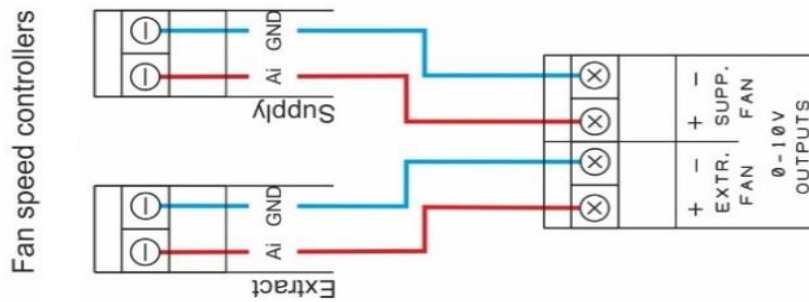

Access & Navigate Settings

There are two internal 'Settings' Dipswitches (1 and 2).

Turn the key to the Off Position, turn one of the settings dip switches on (1 or 2) and then turn the key back to the on position. A menu list will be displayed and will differ depending on which switch is turned on.

Menu Screen: Switch 1

| | |
|----------------------|------------|
| GAS PROVING | OFF |
| FILL TIME | 5 |
| PROVE TIME (sec.) | 30 |
| FAN OVERRUN (min.) | OFF |
| AUTO RESET | OFF |
| EMERGENCY SELECTION | FANS OFF |
| BMS SELECTION | OFF |
| FIRE PANEL SELECTION | FANS OFF |

| | |
|--------------------------|----------|
| BOOST TIME (min.) | 1 |
| | |
| FACTORY RESET | |

Menu Screen: Switch 2

| | |
|------------------------------|------------|
| GAS METER CALIBRATION | - |
| SOLID FUEL PROTECTION | OFF |
| EXTRACT FAN MIN SPEED | 5 |
| SUPPLY FAN MIN SPEED | 5 |
| EXTRACT FAN ENABLE | NC |
| SUPPLY FAN ENABLE | NC |
| FACTORY RESET | |



















Navigate Menu

- Use ▲ or ▼ to select function (*selection highlighted green*).
- Press **OK** button (*green frame will change to red*).
- Use ▲ or ▼ to select appropriate value.
- Press **OK** button and wait until red frame returns to green.

Settings Switch #1 Overview

| Menu | Description | Default |
|----------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------|
| GAS PROVING | This system proves by pressure testing that all gas taps and appliances are isolated before the main gas valve will open. If you require gas pressure proving, enable by selecting ON and adjust the initial FILL and PROVE times before the valve will open upon start up. | OFF |
| FILL TIME | Gas Proving must be enabled. Fill the gas supply line for 5, 10, 15 or 20 seconds. | 5s |
| PROVE TIME | Gas Proving must be enabled. Check the integrity of supply for 30, 45, 60, 75 or 90 seconds. | 30s |
| FAN OVERRUN | An option for cooling the duct for a period when the 3000S is switched off by key. Fan Overrun can be set from a period of 1 to 30 minutes. All input and outputs will be switched off and only the fans will remain in operation. | OFF |
| AUTO RESET | In the event of a power loss the 3000S must be restarted manually by key switch. When auto-reset is ON it will instruct the system to restart automatically when power is restored. | OFF |
| EMERGENCY SELECTION | <p>The Merlin 3000S has a four (4) combination emergency selection feature:</p> <ul style="list-style-type: none"> • FANS OFF - Extract & Supply fan OFF (default). • FANS ON - Extract & Supply fan ON at maximum speed. • SUPP ON – Extract fan is OFF / Supply fan ON at maximum speed. • EXTR ON – Supply fan is OFF / Extract fan ON at maximum speed. <p>Each option instructs the 3000S to shut down the gas supply and contactor when Emergency Shutoff devices are activated.</p> | OFF |
| BMS SELECTION | <p>This will tell the BMS whether there is a gas supply. Factory set to OFF which signals the BMS when the gas valve is open or closed.</p> <p>When switched to ON, the 3000S will signal the BMS on any error fault, i.e., High CO2 or gas levels via detectors, Emergency shutoff activated, etc.</p> | OFF |
| FIRE PANEL SELECTION | <p>The Merlin 3000S has a four (4) combination fire panel selection feature:</p> <ul style="list-style-type: none"> • FANS OFF - Extract & Supply fan OFF (default). • FANS ON - Extract & Supply fan ON at maximum speed. • SUPP ON – Extract fan is OFF / Supply fan ON at maximum speed. • EXTR ON – Supply fan is OFF / Extract fan ON at maximum speed. <p>Each option instructs the 3000S to shut down gas supply and electrical contactor upon activation by Fire Alarm via the fire panel.</p> | OFF |
| FACTORY RESET | All settings from the settings #1 menu can be restored to default. | N/A |

Settings Switch #2 Overview

| Menu | Description | Default | | | | | | | | | | | | | | | | | | |
|-------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------|------------------------------------------|-------------------------------------|---|---|---|----------------------------------------------------------------------------------------|----|---|-------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------|--|--------------------------|--|--|-------------------------------------------|--|------------|
| <p>GAS METER CALIBRATION</p> | <p>Select [GAS METER CALIBRATION] option.</p> <ul style="list-style-type: none"> ➤ Fans start operating at max speed and the gas valve will open. ➤ Turn all appliances on and set gas to maximum. ➤ When all appliances are ready - press OK. ➤ Calibration can take up to 3 minutes. ➤ Whilst calibrating, the screen opposite will be displayed <div data-bbox="632 667 1050 902" style="border: 1px solid black; padding: 5px; text-align: center;"> <p>IMPORTANT: Please ensure ALL sources of gas are set to maximum prior to calibration. PRESS OK TO START</p>  </div> <p>The Merlin 3000S will then confirm successful calibration</p> <div data-bbox="507 992 1174 1330" style="border: 1px solid black; padding: 5px;"> <table style="width: 100%; text-align: center;"> <tr> <td style="width: 33%;">Number of pulses from single reading</td> <td style="width: 33%;">Number of average pulses from 3 readings</td> <td style="width: 33%;">Calibration time for single reading</td> </tr> <tr> <td>↓</td> <td>↓</td> <td>↓</td> </tr> <tr> <td> 17</td> <td>17</td> <td>8</td> </tr> <tr> <td> Flow gas meter</td> <td> ON  ON</td> <td> Calib. time (s)</td> </tr> <tr> <td></td> <td>↙ ↘</td> <td></td> </tr> <tr> <td></td> <td>Gas valve ON Fans ON</td> <td></td> </tr> </table> </div> <p>If the system encounters a problem – the screen may display the following.</p> <div data-bbox="379 1417 799 1653" style="border: 1px solid black; padding: 5px; text-align: center;"> <p>IMPORTANT: Please ensure ALL sources of gas are set to maximum prior to calibration. NO GAS FLOW DETECTED</p>  </div> <p style="text-align: center;"><i>Too many pulses</i></p> <div data-bbox="895 1417 1315 1653" style="border: 1px solid black; padding: 5px; text-align: center;"> <p>IMPORTANT: Please ensure ALL sources of gas are set to maximum prior to calibration. NO GAS FLOW DETECTED</p>  </div> <p style="text-align: center;"><i>Not enough pulses</i></p> <p>The 3000S will automatically increase the calibration time when it receives less than 12 pulses within 5 seconds and decreases calibration time when receiving more than 999 pulses within 5 seconds. Calibration is possible only when the 3000S receives 12 to 998 pulses within 2 to 60 seconds.</p> <p>The system will measure three times the number of pulses and save an average value. The calibration time will have an influence on the fan speed response time in relation to CO₂ value and duct temperature</p> | Number of pulses from single reading | Number of average pulses from 3 readings | Calibration time for single reading | ↓ | ↓ | ↓ |  17 | 17 | 8 |  Flow gas meter |  ON  ON |  Calib. time (s) | | ↙ ↘ | | | Gas valve ON Fans ON | | <p>OFF</p> |
| Number of pulses from single reading | Number of average pulses from 3 readings | Calibration time for single reading | | | | | | | | | | | | | | | | | | |
| ↓ | ↓ | ↓ | | | | | | | | | | | | | | | | | | |
|  17 | 17 | 8 | | | | | | | | | | | | | | | | | | |
|  Flow gas meter |  ON  ON |  Calib. time (s) | | | | | | | | | | | | | | | | | | |
| | ↙ ↘ | | | | | | | | | | | | | | | | | | | |
| | Gas valve ON Fans ON | | | | | | | | | | | | | | | | | | | |

| | | |
|---------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----|
| SOLID FUEL PROTECTION | The Merlin 3000S has a built-in solid fuel protection feature. When the 3000S is switched OFF and solid fuel protection is set to ON it will instruct the system to continue to check the Detector, CO ₂ Monitor and Duct Temperature if applicable. | OFF |
| EXTRACT FAN MINIMUM SPEED | Setup the minimum speed for extract fan ranging from 1 – 10 volts (displayed in bars). | 5V |
| SUPPLY FAN MINIMUM SPEED | Setup minimum speed for supply fan in range from 1 – 9 volts (displayed in bars). WE DO NOT RECOMMEND A SUPPLY FAN SPEED HIGHER THAN EXTRACT FAN SPEED. | 5V |
| EXTRACT FAN ENABLE | The Merlin 3000S has a built-in fan speed control - ON/OFF feature. This can work as N/O or N/C. | NC |
| SUPPLY FAN ENABLE | The Merlin 3000S has a built fan speed control - ON/OFF feature. This can work as N/O or N/C. | NC |
| FACTORY RESET | All settings from the settings #2 menu can be restored to default. | N/A |

Duct Temperature vs 0-10V Fan Output

| Volt | Temp (C°) | | Minimum Speed - 1V | |
|------|-----------|-------|---------------------------------------------|--------------------------------------------|
| | From | Up to | Extract fan 0-10V out (At minimum speed) | Supply fan 0-10V out (At minimum speed) |
| 0 | <25 | 25 | 0 | 0.0 |
| 1 | 25.1 | 30 | 1.9 | 1.7 |
| 2 | 30.1 | 35 | 2.8 | 2.5 |
| 3 | 35.1 | 40 | 3.7 | 3.3 |
| 4 | 40.1 | 45 | 4.6 | 4.1 |
| 5 | 45.1 | 50 | 5.5 | 5.0 |
| 6 | 50.1 | 55 | 6.4 | 5.8 |
| 7 | 55.1 | 60 | 7.3 | 6.6 |
| 8 | 60.1 | 65 | 8.2 | 7.4 |
| 9 | 65.1 | 73 | 9.1 | 8.2 |
| 10 | >73.1 | | 10 | 9.0 |


| Volt | Temp (C°) | | Minimum Speed - 5V | |
|------|-----------|-------|---------------------------------------------|--------------------------------------------|
| | From | Up to | Extract fan 0-10V out (At minimum speed) | Supply fan 0-10V out (At minimum speed) |
| 0 | <25 | 25 | 0 | 0.0 |
| 1 | 25.1 | 30 | 5.5 | 5.0 |
| 2 | 30.1 | 35 | 6.0 | 5.4 |
| 3 | 35.1 | 40 | 6.5 | 5.9 |
| 4 | 40.1 | 45 | 7.0 | 6.3 |
| 5 | 45.1 | 50 | 7.5 | 6.8 |
| 6 | 50.1 | 55 | 8.0 | 7.2 |
| 7 | 55.1 | 60 | 8.5 | 7.7 |
| 8 | 60.1 | 65 | 9.0 | 8.1 |
| 9 | 65.1 | 73 | 9.5 | 8.6 |
| 10 | >73.1 | | 10.0 | 9.0 |

Operation

Initial Power Up

To turn the unit ON - Turn the key switch to ON position. When the system is connected to the mains electrical supply, the red dot of the S&S logo located on the bottom of the panel will illuminate. When no power is present, this LED will not illuminate.

Upon powering up the 3000S, the system will display the following screen until the fan/s reach the speed set by the engineer. After the fan/s have reached the desired settings, the system will continue as normal.

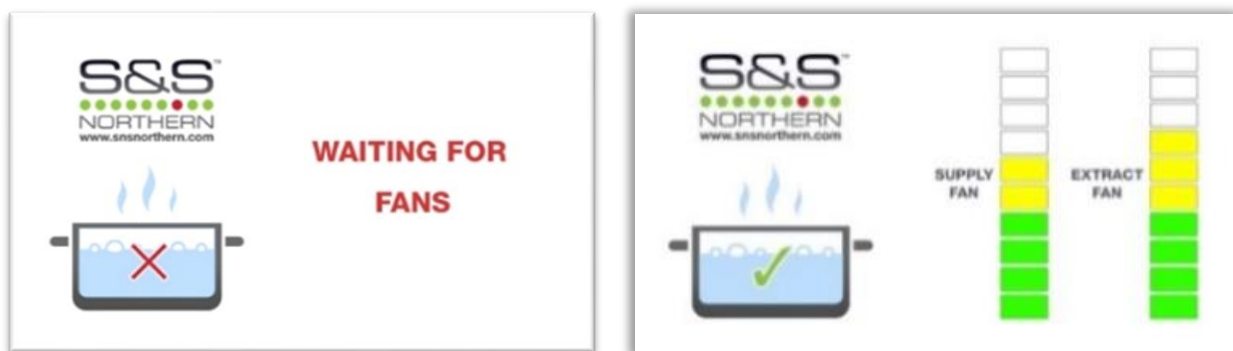

Under normal conditions – The display will show fan speed.

When 'Fan Overrun Time' is enabled the screen will display the period run time. To deactivate - press emergency button or switch key ON.



Adjust the Screen Brightness

Hold the UP [▲] button on the front panel for ~3 seconds until the panel beeps. Press UP again to select three brightness levels (High / Medium / Low).

Once you have selected your desired brightness, leave the panel for ~5 seconds and the brightness will set.

Fan Boost Button

To boost the ventilation and prompt maximum fan speed - Press and Release the [Boost] button located on front fascia and the pre-selected boost time will display on screen. When boost time reaches zero, the fans will automatically return to normal operating mode.

To turn boost mode off - Press and Release the [Boost] button located on front fascia - the system will return to normal operation.



Warning Status Screens





CO₂ HIGH Using 0-10V Input Terminals.

When CO₂ gas is detected above alarm level (see *CO₂ Monitor manual*) the screen will display CO₂ HIGH indication and the fans output will be at maximum speed. When the CO₂ gas returns below alarm level, the system will return to normal operation.

SMOKE / STEAM DETECTED

When smoke or steam is detected continuously for ~3 seconds, the warning screen will appear, and the fans will operate at maximum speed. When smoke or steam is not detected continuously for ~5 seconds the system will automatically return to normal.

When smoke or steam is detected for longer than 30minutes, the panel will buzz intermittently, and the warning screen will appear to prompt a cleaning of the optical sensors.

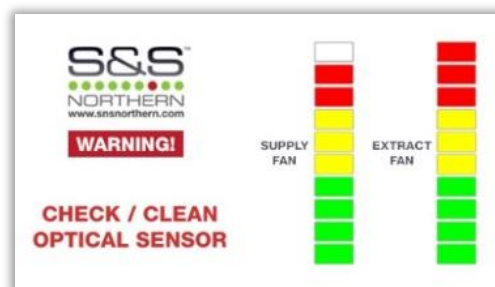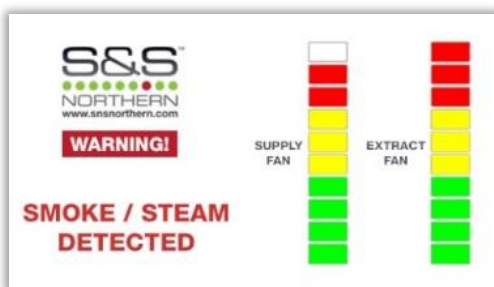

DUCT TEMPERATURE HIGH

When the temperature in the extraction duct reaches or rises above 30°C, the fans will be driven at a speed dependant on the temperature. When the temperature in the extraction duct reaches or rises above 73°C, the warning screen will appear and the fans will be driven at maximum speed.

When the temperature in the extraction duct drops below 73°C, the warning screen will disappear, and the fans will continue at a speed dependant on the temperature.


When the temperature drops below 30°C, system will automatically return to normal.



Fault Status Screens



EMERGENCY STOP If an emergency stop button (remotely or direct) is pressed, the gas and contactor will shut off. Fans can be driven in a combination upon emergency stop activation– *see settings*. The Emergency Stop must be reset before restarting the system.

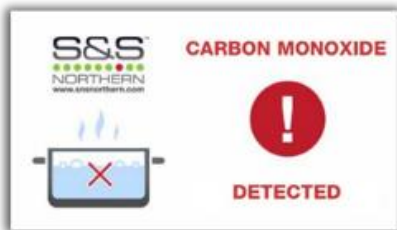

CARBON MONOXIDE DETECTED If the connected CO Detector detects high concentrations of CO gas, the gas and contactor will shut off and fans will run at maximum speed.



CO₂ HIGH When CO₂ gases rise above alarm level (*see CO₂ Monitor manual*) the fault screen will appear. The gas and contactor will shut off and fans will run at maximum speed.



FIRE ALARM ACTIVATED If the connected fire panel detects a fire the gas and contactor will shut off. Fans can be driven in 4 combinations – *see settings*.



LOW GAS PRESSURE When gas supply pressure drops below 12mBar for 10 seconds the fault screen will appear and the gas valve, contactor and the fans will all shut off.



GAS PRESSURE TEST FAIL If the gas pressure test drops by more than 10% below 12mBar the test will fail.



SUPPLY & EXTRACT FAN FAULT If a supply or extract fan fault is detected for longer than 20 seconds - the gas, contactor and fans will all shut off.



SOLID FUEL FEATURE PROTECTION The Merlin 3000S has a built-in solid fuel protection feature. When the system is switched off and the solid fuel protection is set to ON it will continue to instruct the system to check the CO Detector, CO₂ Monitor & Duct Temperature if applicable.

When all the above faults are rectified and safe, the system will automatically shut down again.

Maintenance

Keep your panel in good working order - follow these basic principles.

- Remove any dust/debris from the outer enclosure regularly using a slightly damp cloth.
- Never use detergents or solvents to clean your device.
- Never spray air fresheners, hair spray, paint, or other aerosols near the device.
- Never paint the device.

Technical Specification

| General | |
|-----------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Model: | Merlin 3000S |
| Size: (H x W x D) | 7.08 x 10.03 x 3" (180 x 255 x 77 mm) |
| Housing Material: | ABS Polyac - PA765 (Flame Rating UL94 V-1) |
| Mounting: | Indoor use - Wall Mounting |
| Weight: | 1.7kg (3.74lb) |
| User Interface | |
| Display: | 4.3" TFT Touch Screen |
| Screen Brightness: | Adjustable 0-100% |
| Audible Alarm: | >60dB @ 3.28ft (1m). Quiet conditions. |
| Language: | English |
| Power Supply | |
| Power Consumption: | 6.9W max. |
| AC Power Rating: | 100-240V~ 50/60Hz |
| Maximum Current: | 28mA |
| Extract/Supply Fan Output | 0.5A Max |
| Internal Fuse: | T3.15A L250V |
| Equipment | |
| Overvoltage Category: | II |
| Pollution Degree: | 2 |
| Equipment Class: | 2 |
| Environmental | |
| Operating: | -10 ~ 50°C / 14 ~ 122°F 30 ~ 80% RH (non-condensing) |
| Storage: | -25 ~ 50°C / -13~122F° up to 95% RH (non-condensing) |
| Altitude Rating: | 2000m |
| Wiring | |
| Typical | 100-240V AC Rated terminals #18-12AWG-Tinned Copper Other: #18-14AWG-Tinned Copper. For field connections use wires suitable for at least 75°C (167°F) |
| Approvals | |
| Electromagnetic Compatibility and Electrical Safety | EN 61326-1:2013 IEC BS EN 61010-1 |

Installation Details

Please pass this manual to the system owner / user.

| | |
|------------------------------------------|--|
| Date of Installation: | |
| Installation Location: | |
| Organisation: | |
| Stamp/Signature of the installer: | |

Every effort is made to ensure the accuracy of this document; however, S&S Northern can assume no responsibility for any errors or omissions in this document or their consequences. S&S would greatly appreciate being informed of any errors or omissions that may be found in the content of this document. For information not covered in this document, or if there is a requirement to send comments/corrections, please contact S&S using the contact details.

S&S Northern Head Office

Tel: +44(0) 1257 470 983

Fax: +44(0) 1257 471 937

www.snsnorthern.com

info@snsnorthern.com

Southeast Division

Tel: +44(0) 1702 291 725

Fax: +44(0) 1702 299 148

south@snsnorthern.com



S&S Northern is the owner of this document and reserves all rights of modification without prior notice.